

Evidence of performance
Airborne sound insulation building components

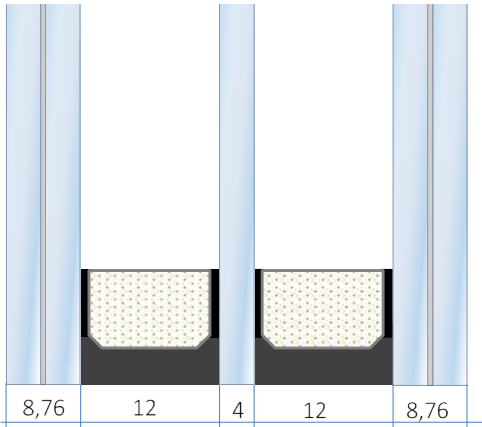
Test Report

No. GLA-1255.6/16Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	44.2 / 12 / 4 / 12 / 44.2
Designation:	Laminated glass 44.2 class P2A / 12+Ar / FL 4 / 12+Ar / Laminated glass 44.2 class P2A
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

<i>Rating</i>	R_w (C; C_{tr})	STC	OITC
<i>Basis</i>	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
<i>Value</i>	39 (-3; -8) dB	39 dB	28 dB

Łozienica, 05.05.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory