

Evidence of performance
Airborne sound insulation of building components

Test Report

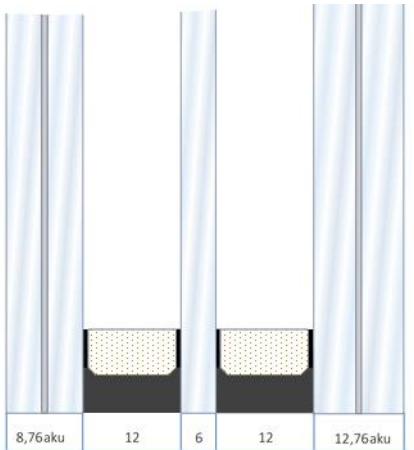
No. GLA-1277.1/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	8,76Aku/12/6/12/12,76Aku
Designation:	44.2 TH1,1 Phon class P2A / 12 / FL 6 / 12 / VSG (TH1,1 6 / 0,76 PVB SC / FL 6) class 1/B/1 Ar
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	R_w (C; C _{tr})	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	48 (-3; -8) dB	48 dB	36 dB

Łozienica, 12.09.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory