

**Evidence of performance**  
**Airborne sound insulation of building components**

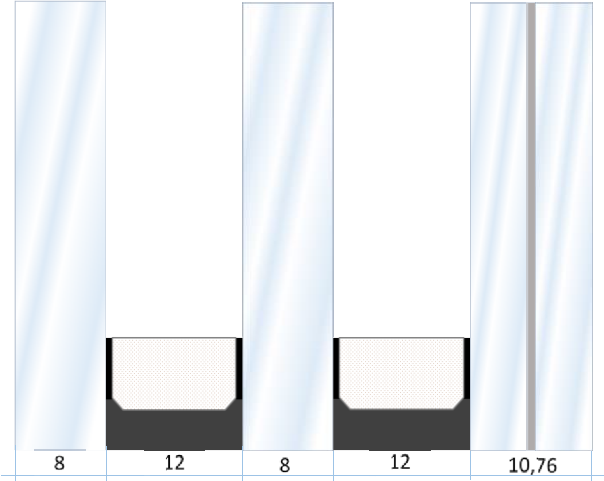
Test Report

**No. GLA-1288.10/16**Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	8/12/8/12/10,76
Designation:	TH1,1 8 /12 /FL 8 / 12 / 55.2 TH1,1 class P2A Ar
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	$R_w$ (C; C <sub>tr</sub> )	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	<b>44 (-3; -7) dB</b>	<b>44 dB</b>	<b>33 dB</b>

Łozienica, 7.12.2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory